



Warsaw, 21.02.2011

Thermal Physics, Sanitary
Systems and
Environment Department

02-656 Warsaw, Ksawerow 21
tel.: (+48 22) 849-36-15
fax.: (+48 22) 566-42-76
e-mail: fizyka@itb.pl

CLIENT

M&S POMORSKA FABRYKA OKIEN Sp. z o. o.
GROTTGERA 15
76 – 200 SLUPSK


REGARD: LFS00-0615/11/ZOONF

OBJECT: TITANthermo PVC-U window of Bruegmann system AD with thermal reinforcement MS

TEST RESULT: the thermal transmittance for frame above-mentioned window (below technical drawing) according to EN 12412-2:2005

$$U_f = 1,0 \text{ W}/(\text{m}^2 \cdot \text{K})$$

SOURCE DOCUMENT: test report No LFS00-0615/11/ZOONF

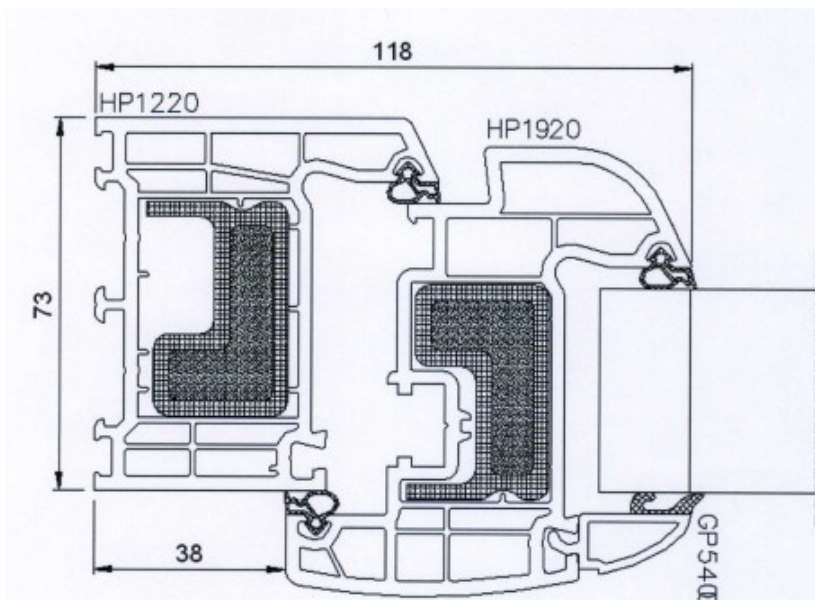

KIEROWNIK
ZAKŁADU FIZYKI Ciepłej,
INSTALACJI SANITARNYCH I ŚRODOWISKA
dr inż. Krzysztof Kasperkiewicz